
## DRAWING NOTES

1 PROVIDE TWO (2) DATA OUTLETS FOR CONNECTION TO BUILDING MANAGEMENT SYSTEM PANELS (TO BE INSTALLED BY OTHERS). COORDINATE WITH BMS CONTRACTOR FOR LOCATION OF BMS PANELS IN FIELD. ASSUME 300 LINEAR FEET FROM DATA OUTLETS FOR BMS PANELS TO DATA RACK/CABINET.

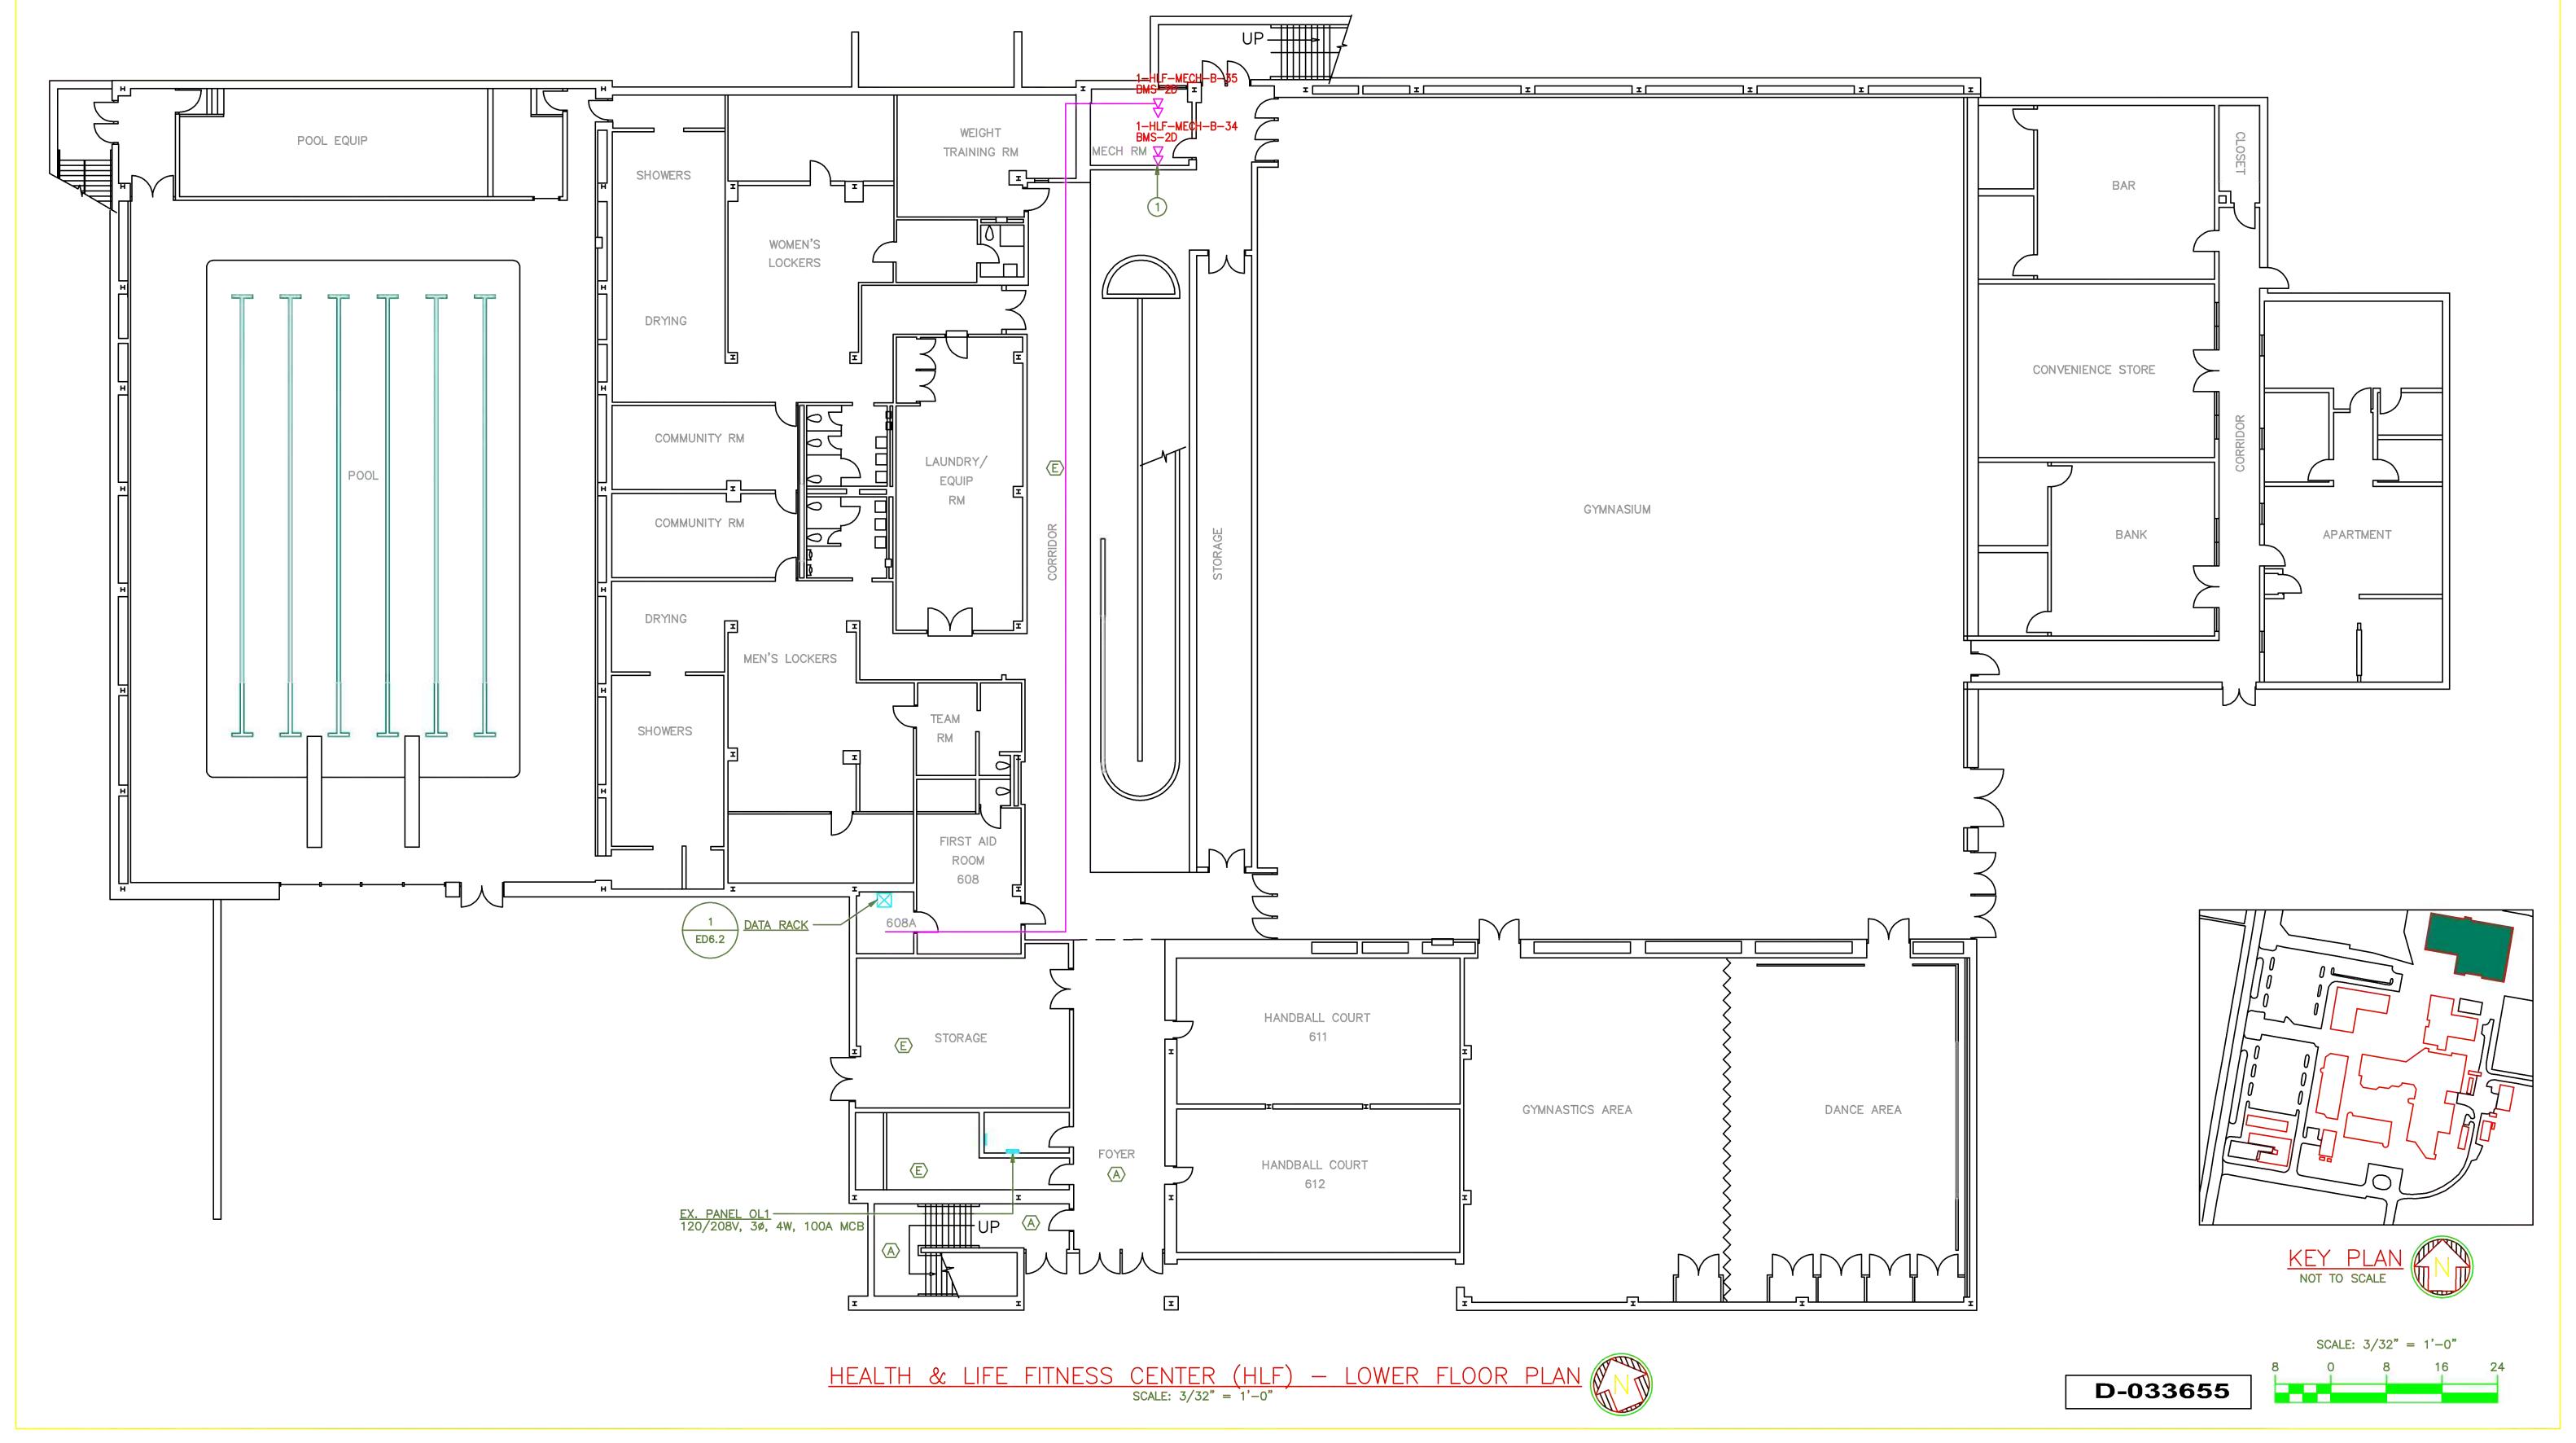

CCBC DUNDALK
BUILDING
FLOOR PLAN